




NARMADA CONTROL AUTHORITY, REGIONAL OFFICE
HYDROLOGY DIRECTORATE, INDORE
Daily Status of Narmada River Basin at 08:00 hrs. on 29 July, 2021



S. No	Name of Station	FRL/Danger level	Water Level	Live Storage as on today	Inflow/ # Discharge	Average Outflows during last 24 hrs.					RAINFALL		Rainfall in other sites during the last 24 hours in mm	
		Meter	Metre	MCM	Cumecc	Spillway	PH Rel.		HR Rel.	Total Rel.	24 Hrs	Σ fr. 15 June		
							Cumecc	RBPB						
1	Bargi Reservoir	422.76	416.60	1660	1590	-	182.9	-	13.9	196.8	7.8	119.6	Toranmal	47.6
2	Burmanghat	322.00	309.84	-	319	-	-	-	-	-	0.4	378.2	Amgaon	22.6
3	Tawa Reservoir	355.40	349.27	968	262	-	-	-	0.4	0.4	-	508.8	Betul Bazar	20.6
4	Hoshangabad	293.83	285.90	-	886	-	-	-	-	-	10.0	305.8	Dharpuri	14.0
5	ISP Reservoir	262.13	248.46	1431	1412	-	75.6	-	-	75.6	11.2	350.2	Man	12.0
6	OSP Reservoir	196.60	195.01	140	192	-	70.0	-	15.3	85.2	42.8	370.0		
7	Maheshwar Reservoir	162.76	146.00	-	-	-	-	-	-	-	6.8	189.6		
8	SSP Reservoir	138.68	116.51	720	250	-	0.0	179.5	198.5 [§]	179.5	2.0	171.4		

Power Generation from Sardar Sarovar Project **0.875 MU**s

Average discharge measured at (i) Godbole Weir **627 (08.45hrs) Cusecs** Garudeshwar Weir **1033 Cusecs** Ex-MP Releases **2471 Cusecs**
(ii) Gujarat-Rajasthan Border **166** **6.04 MCM**

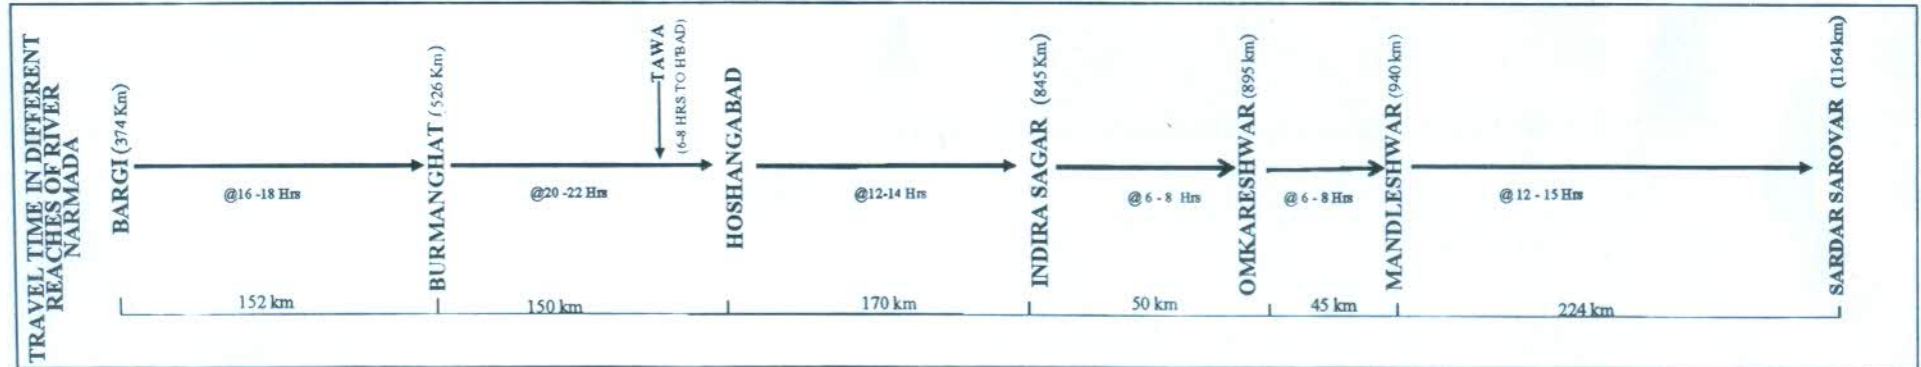

Note: # - Water level, Discharge (at G&D site) & Live Storage are at 08:00 hrs on the day # - Inflow (into reservoir), Spillway, PH & HR releases are 24 hours average of preceding day.
§ - Water released through CHPH/IBPT is diverted to HR of NMC & Godbole gate for env. use.

Copy forwarded to

- NCA : Executive Member, Member(Civil/Power/E&R), Chief Engineer, Director (Civil), Director (IA&R), SE (EMC), NCA, Indore.
- GoMP: Vice Chairman, NVDA, Member (Engg), NVDA, Bhopal
- GoG : Director (Civil), SSNNL, Gandhi Nagar, Chief Engineer (D&V), SSNNL, Vadodara, SE (Design), SSNNL, Vadodara
- GoM : Chief Engineer, Tapi Irrigation Development Corporation Ltd. Jalgaon.
- GoR : Chief Engineer, NMC, Sanchore

(R Parmar) 29/7/21
Assistant Director (HM)