



NARMADA CONTROL AUTHORITY, REGIONAL OFFICE HYDROLOGY DIRECTORATE, INDORE


Daily Status of Narmada River Basin at 08:00 hrs. on 08 August, 2021



S. No	Name of Station	FRL/Danger level	Water Level	Live Storage as on today	Inflow/ # Discharge	Average Outflows during last 24 hrs.					RAINFALL		Rainfall in other sites during the last 24 hours in mm	
						Spillway	PH Rel.		HR Rel.	Total ReL.	24 Hrs	Σ fr. 15 June		
		Meter	Metre	MCM	Cumec		Cumec	RBPH						
1	Bargi Reservoir	422.76	419.10	2198	531	-	167.9	28.9	5.0	201.9	-	163.9	Rajpur	12.6
2	Burmanghat	322.00	309.48	-	248	-	-	-	-	-	-	492.2	Alirajpur	10.6
3	Tawa Reservoir	355.40	351.62	1286	277	-	-	-	0.4	0.4	1.0	584.0		
4	Hoshangabad	293.83	285.96	-	932	-	-	-	-	-	1.2	396.4		
5	ISP Reservoir	262.13	250.53	2187	1673	-	768.9	-	-	768.9	1.0	365.2		
6	OSP Reservoir	196.60	194.71	114	604	-	619.2	-	8.0	627.2	-	375.4		
7	Maheshwar Reservoir	162.76	146.40	-	-	-	-	-	-	-	8.0	221.6		
8	SSP Reservoir	138.68	116.27	685	344	-	0.0	324.3	340.0 ^{\$}	324.3	-	174.2		

Power Generation from Sardar Sarovar Project **1.389 MU**

Average discharge measured at (i) Godbole Weir **625 (09.45hrs) Cusecs** Garudeshwar Weir **653 Cusecs** Ex-MP Releases **21867 Cusecs**
(ii) Gujarat-Rajasthan Border **279** **53.50 MCM**

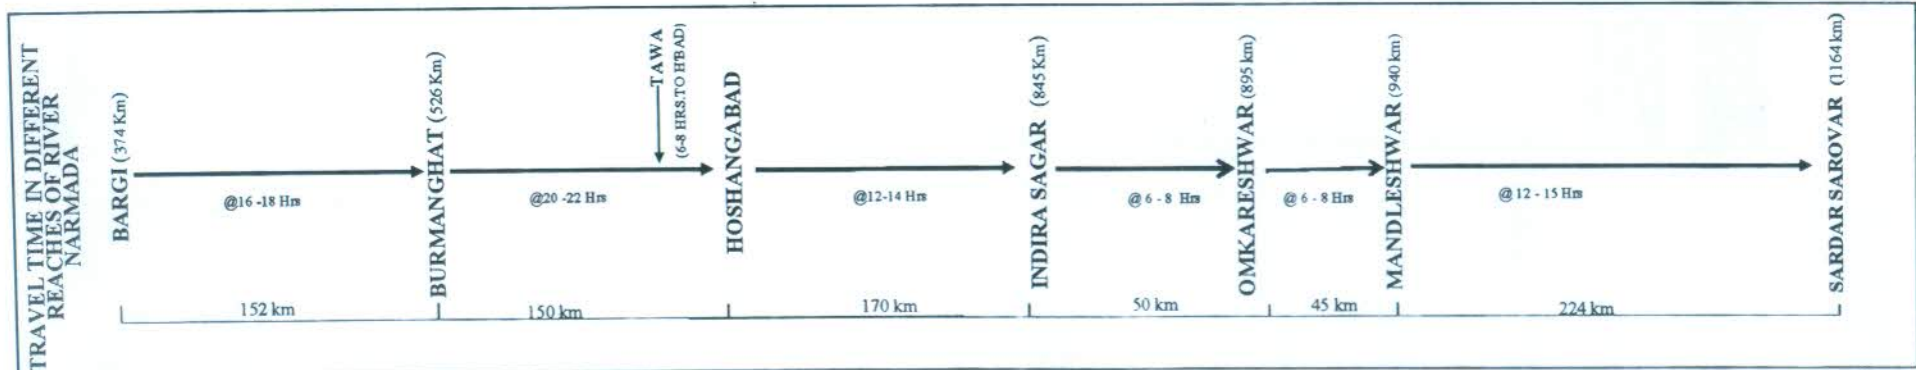

Note: # - Water level, Discharge (at G&D site) & Live Storage are at 08:00 hrs on the day. # - Inflow (into reservoir), Spillway, PH & HR releases are 24 hours average of preceding day.
 \$ - Water released through CHPH/IBPT is diverted to HR of NMC & Godbole gate for env. use.

Copy forwarded to

- NCA : Executive Member, Member(Civil/Power/E&R), Chief Engineer, Director (Civil), Director (IA&R), SE (EMC), NCA, Indore.
- GoMP : Vice Chairman, NVDA, Member (Engg), NVDA, Bhopal
- GoG : Director (Civil), SSNNL, Gandhi Nagar, Chief Engineer (D&V), SSNNL, Vadodara. SE (Design), SSNNL, Vadodara
- GoM : Chief Engineer, Tapi Irrigation Development Corporation Ltd. Jalgaon.
- GoR : Chief Engineer, NMC, Sanchore

For
(Signature)
 08/08/21
 JE(C)

(R Parmar)
 Assistant Director (HM)