



NARMADA CONTROL AUTHORITY, REGIONAL OFFICE

HYDROLOGY DIRECTORATE, INDORE

Daily Status of Narmada River Basin at 08:00 hrs. on 13 November, 2022




S. No	Name of Station	FRL/Danger level	Water Level	Live Storage as on today	% w.r.to Live Storage at FRL	Inflow/ # Discharge	Average Outflows during last 24 hrs.				Remark	
		Meter	Metre	MCM	%		Cumec	PH Rel.		HR Rel.		Total Rel.
								Cumec	RBPH	CHPH		Cumec
1	Bargi Reservoir	422.76	422.45	3114	98%	65	-	186.9	-	3.0	189.9	
2	Burmanghat	322.00	309.02	-		172						
3	Tawa Reservoir	355.40	355.31	1926	-	66	-	-	119.5	125.1	125.1	
4	Hoshangabad	293.83	285.02			335						
5	ISP Reservoir	262.13	261.83	9044	97%	345	-	283.8	-	70.0	353.8	
6	OSP Reservoir	196.60	193.32	-	-	296	-	117.7	-	68.1	185.9	
7	Maheshwar Reservoir	162.76	145.90	-								
8	SSP Reservoir	138.68	137.09	5259	92%	245	-	118.3	539.6	582.8 ^S	657.9	

Power Generation from Sardar Sarovar Project 7.600 MU^s

Average discharge measured at (i) Godbole Weir 17.44 (11 hrs) Cumec
(ii) Gujarat-Raj. Border 34.55 Cumec

Garudeshwar Weir 21 Cumec measured on 12.11.2022

Ex-MP Releases 117.7 Cumec
10.2 MCM

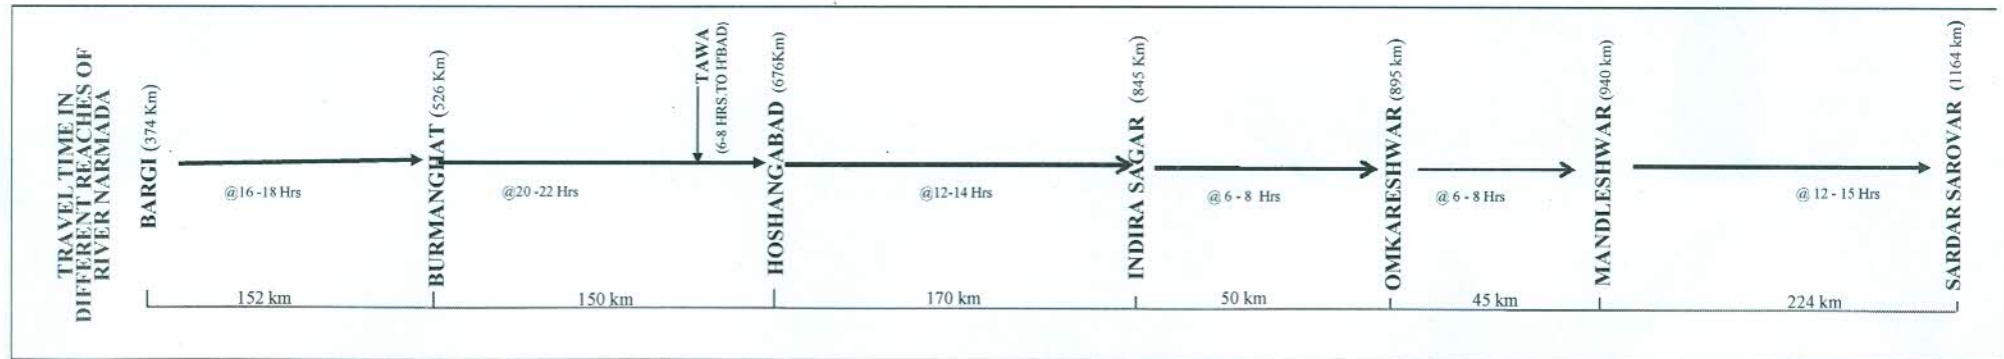

Note: # -The above information on inflow is indicative and on the basis of data provided by project Authorities. Evaporation in all the reservoirs needs to be included in water balancing.
Water level, Discharge (at G&D site) & Live Storage are at 08:00 hrs on the day. Inflow (into reservoir), Spillway, PH & HR releases are 24 hours average of preceding day.
\$ -Water released through CHPH/IBPT is diverted to HR of NMC & Godbole gate for env. use.

Copy with Compliment to :-

NCA : Executive Member, Member(Civil/Power/E&R), Chief Engineer, Director (Civil), Director (IA&R), SE (EMC), NCA, Indore.
GoMP : Vice Chairman, NVDA, Member (Engg), NVDA, Bhopal
GoG : Director (Civil), SSNNL, Gandhi Nagar, Chief Engineer (D&V), SSNNL, Vadodara, SE (Design), SSNNL, Vadodara
GoM : Chief Engineer, Tapi Irrigation Development Corporation Ltd. Jalgaon.
GoR : Chief Engineer, NMC, Sanchore

(R Parmar)
Assistant Director (HM)