



NARMADA CONTROL AUTHORITY, REGIONAL OFFICE HYDROLOGY DIRECTORATE, INDORE




Daily Status of Narmada River Basin at 08:00 hrs. on 17 June, 2021

S. No	Name of Station	FRL/Danger level Meter	Water Level Metre	Live Storage as on today MCM	Inflow/ # Discharge Cumec	Average Outflows during last 24 hrs.				RAINFALL		Rainfall in other sites during the last 24 hours in mm	
						Spillway Cumec	PH Rel. Cumec	HR Rel. Cumec	Total Rel. Cumec	24 Hrs mm	Σ fr. 15June mm		
1	Bargi Reservoir	422.76	414.85	1326	121	-	105.9	2.0	107.9	-	10.4	Khandwa	43.2
2	Burmanghat	322.00	308.44	-	96					-	12.8	Kannod	21.0
3	Tawa Reservoir	355.40	339.64	145	268	-	-	0.4	0.4	27.8	27.8	Barna	14.5
4	Hoshangabad	293.83	284.97	-	311					17.4	24.0	Kolar	12.0
5	ISP Reservoir	262.13	247.60	1152	823	-	1214.0	60.0	1274.0	12.0	26.2		
6	OSP Reservoir	196.60	194.70	113	1279	-	671.1	62.1	733.2	-	-		
7	Maheshwar Reservoir	162.76	147.10	-	-					-	-		
8	SSP Reservoir	138.68	116.43	708	487	-	1122.0 *	352.9 §	1122.0	2.0	2.0		

Power Generation from Sardar Sarovar Project **18.096 MU**

Average discharge measured at (i) Godbole Weir **615 (9:30Hrs) Cusecs** Garudeshwar Weir **37118 Cusecs** Ex-MP Releases **23698 Cusecs**
(ii) Gujarat-Rajasthan Border **305 Cusecs** **57.98 MCM**

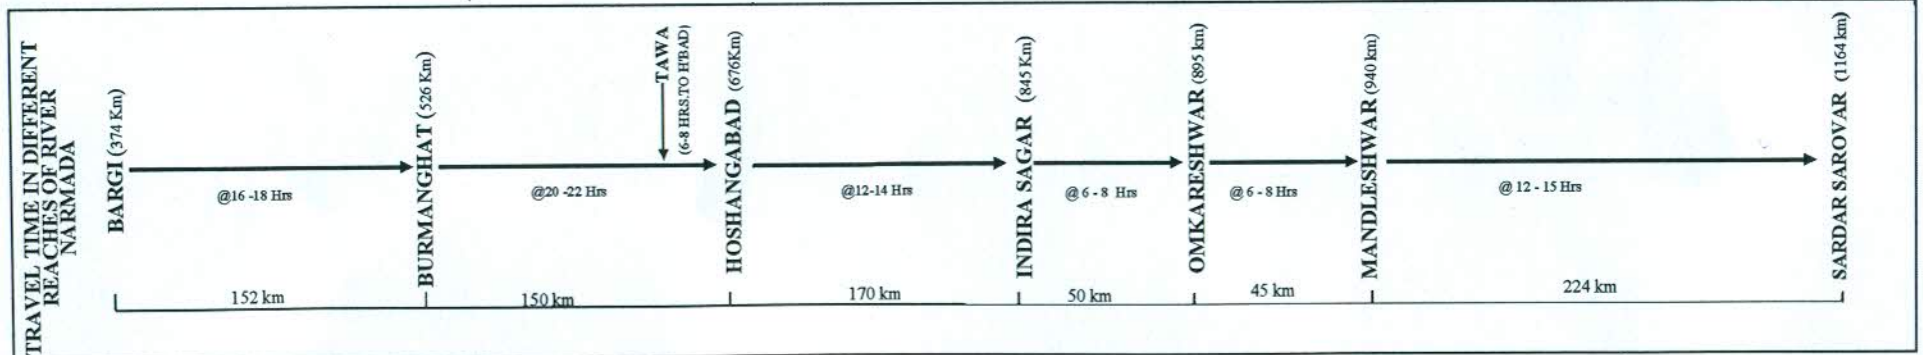

Note: # - Water level, Discharge (at G&D site) & Live Storage are at 08:00 hrs on the day. # - Inflow (into reservoir), Spillway, PH & HR releases are 24 hours average of preceding day.
§ - Water released through CHPH/IBPT is diverted to HR of NMC & Godbole gate for env. use. ** RBPH 792.05 Cumec CHPH 329.98 Cumec.

Copy forwarded to

- NCA : Executive Member, Member(Civil/Power/E&R), Chief Engineer, Director (Civil), Director (IA&R), SE (EMC), NCA, Indore.
- GoMP : Vice Chairman, NVDA, Member (Engg), NVDA, Bhopal
- GoG : Director (Civil), SSNNL, Gandhi Nagar, Chief Engineer (D&V), SSNNL, Vadodara, SE (Design), SSNNL, Vadodara
- GoM : Chief Engineer, Tapi Irrigation Development Corporation Ltd. Jalgaon.
- GoR : Chief Engineer, NMC, Sanchore

(R Parmar) 16/2021
Assistant Director (HM)